

LOCATION 2550 Amber Crest Dr. CITY Castroville
 BETWEEN Red TH STREET & Dead End STREET


	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>10'</u>	<u>Relocated</u> <u>3-15-95</u>		
MAIN TO PROP. LINE						
PROP. LINE TO BLDG.						

ENTERS: 2546 BRANCHED INTO: 2530
 TAP SIZE: 3/4 in PRESSURE 60 P.S.I. _____ INCHES W.C. LOCATION _____

PRESSURE TEST: @ 100 psi For 1 1/4 Hrs. By EP
 MAIN-SIZE 3/4 C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED 1968
 DEPTH: 2 Ft. 0 In. LOCATION _____

"A" P/S READING 1.2 TOTAL ANODES 1* 017 * 0 L.R. # _____

REMARKS: NO Test box Installed PS Reading on Split Service Same, 1.2
2546 - Check point

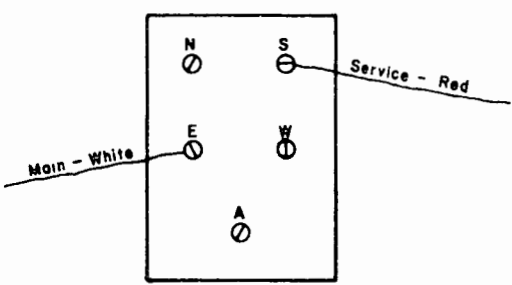

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u> <u>PS in</u>	<u>Plastic</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY