

LOCATION 1715 Anthony Dr. CITY Castroville
BETWEEN Trinity Dr. STREET & Birchwood STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>9W</u>	<u>10'</u>	<u>7-21-98</u>	<u>Relocated</u>	
MAIN TO PROP. LINE						
PROP. LINE TO BLDG.						

ENTERS: 1713 BRANCHED INTO: 1715

TAP SIZE: 3/4 Sec. PRESSURE 60 P.S.I. INCHES W.C. LOCATION


PRESSURE TEST: @ 100 psi For 114 Hrs. By SP

MAIN-SIZE 3/4 C.I. BARE STEEL COATED STEEL ☒ PLASTIC YEAR INSTALLED 1972

DEPTH: 2 Ft. 6 In. LOCATION

"A" P/S READING .85 TOTAL ANODES 1# 17 # L.R. # 10

REMARKS:

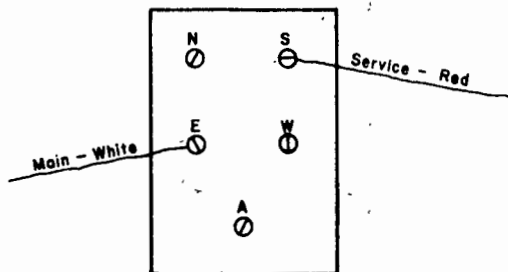

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u> <u>Riser</u>	<u>1.85</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY