

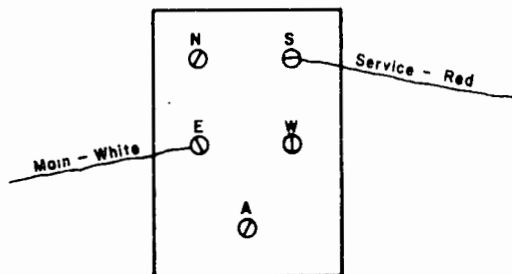
LOCATION 307 AutenCITY GASTONIABETWEEN TuckasegeeSTREET & -

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>15</u>	<u>10-24-94</u>		
MAIN TO PROP. LINE				<u>Relocated riser</u>		
PROP. LINE TO BLDG.						

ENTERS: 307

BRANCHED INTO:

TAP SIZE: 1/2PRESSURE 60 P.S.I. _____ INCHES W.C.LOCATION 72' west ofAutenPRESSURE TEST: @ 100 psi For 1/4 Hrs. By M. ParkerMAIN - SIZE 3/4 C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC K YEAR INSTALLED 94DEPTH: 1 Ft. 6 In. LOCATION 55' South of Tuckasegee"A" P/S READING P TOTAL ANODES 1# _____ 17# _____ L.R. # _____REMARKS: Relocated Riser

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>R. riser</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY