

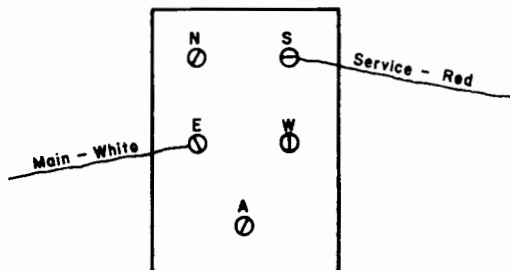
LOCATION 418 S. AvonCITY CassingtonBETWEEN 3rdSTREET & 4th

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>1'</u>		<u>Tied over</u>	<u>29' of EXT</u>
MAIN TO PROP. LINE				<u>10-7-93</u>	<u>3/4 G/W to</u>	<u>EXT 2" P.</u>
PROP. LINE TO BLDG.					<u>Main</u>	

ENTERS: 418BRANCHED INTO: 0TAP SIZE: 1/2 PRESSURE 60 P.S.I. _____ INCHES W.C. LOCATION 14' 50" of Maple
103- E of CoF AvonPRESSURE TEST: @ 100 psi For 64 Hrs. By EPMAIN-SIZE 24 C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1993DEPTH: 3 Ft. 0 In. LOCATION"A" P/S READING Plastic TOTAL ANODES 1# 1 17# _____ L.R. # _____

REMARKS:

Tie in with field OPA at main

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u> <u>Riser</u>	<u>1.1</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY