

LOCATION 202 Beam Rd CITY Gastonia  
BETWEEN Calvary St STREET & S. York Rd STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>CLW</u>	<u>⑤</u>	<u>1981</u>	<u>Put Anode</u>	<u>ON CP 1054</u>
MAIN TO PROP. LINE					<u>System</u>	
PROP. LINE TO BLDG.						

ENTERS: 202

BRANCHED INTO: 202-A-B-C

TAP SIZE: \_\_\_\_\_ PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION \_\_\_\_\_

PRESSURE TEST: @ \_\_\_\_\_ PSI FOR \_\_\_\_\_ HRS. BY \_\_\_\_\_


MAIN-SIZE 3/4 Ser C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL / PLASTIC \_\_\_\_\_ YEAR INSTALLED 1981

DEPTH: \_\_\_\_\_ FT. \_\_\_\_\_ IN. LOCATION \_\_\_\_\_

"A" P/S READING 600 TOTAL ANODES 1# \_\_\_\_\_ 17# 1 L.R. # \_\_\_\_\_

REMARKS:

Put 17<sup>th</sup> Anode into cp. System 1054 1<sup>st</sup> Reading 600  
Service of Service 2<sup>nd</sup> Reading 1000

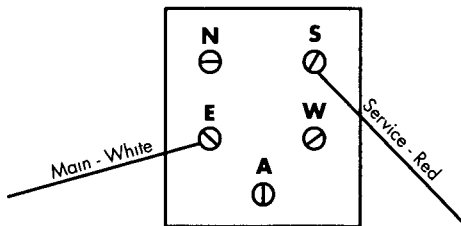

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	
P/S Pipeline Lead - White Existing Main	<u>Pipe</u>	<u>1,000</u>

ENG. DEPT. USE ONLY