

LOCATION 4315 Beatty RdCITY GASTONIABETWEEN COVE Creek

STREET &

STREET


	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>174'</u>	<u>6-2-95</u>		
MAIN TO PROP. LINE	<u>3/4</u>	<u>P</u>	<u>50'</u>			
PROP. LINE TO BLDG.	<u>3/4</u>	<u>P</u>	<u>124'</u>			

ENTERS: 4315

BRANCHED INTO:

TAP SIZE: 3/8 PRESSURE 60 P.S.I. INCHES W.C. LOCATION 15' E ofBeatty RdPRESSURE TEST: @ 100 psi For 1/4 Hrs. By Martin ParkerMAIN-SIZE 6" C.I. BARE STEEL COATED STEEL K PLASTIC YEAR INSTALLED 1995DEPTH: 3 Ft. 0 In. LOCATION"A" P/S READING 1.5 TOTAL ANODES 1* 0 17* 0 L.R. # 233120

REMARKS:

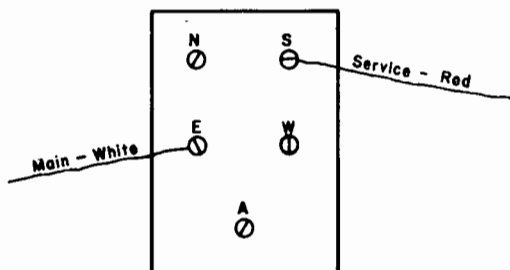

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>PriSER</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY