

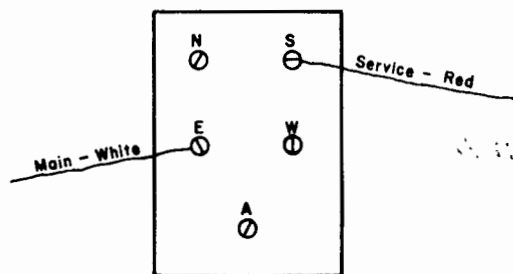
LOCATION 1147 S. BellevueCITY CastrovilleBETWEEN Fairfield Dr.STREET & Edgement

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>2'</u>		<u>Tied over</u>	<u>100' of Ext 3/4</u>
MAIN TO PROP. LINE				<u>9-21-94</u>	<u>Gw son to Ext. 2" Plastic</u>	
PROP. LINE TO BLDG.					<u>MAIN.</u>	

ENTERS: 1147 S. BellevueBRANCHED INTO: 0TAP SIZE: 1/2 PRESSURE 60 P.S.I. INCHES W.C. LOCATIONPRESSURE TEST: @ 100 psi For 1/4 Hrs. By SPMAIN-SIZE 2" C.I. — BARE STEEL — COATED STEEL — PLASTIC ✓ YEAR INSTALLED 1993DEPTH: 3 Ft. 0 In. LOCATION"A" P/S READING D TOTAL ANODES 1* — 17* — L.R. # —

REMARKS:

Tracer wire tied SP at MAIN

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u> <u>Riser</u>	<u>1.1</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY