

LOCATION 1501 Blackwood St. CITY Castroville

BETWEEN Upton St STREET & Easy St. STREET

| | SIZE | TYPE | LENGTH | INSTALLED | RETIRED | RENEWED |
|---------------------|-------------|----------|-------------|----------------|---------|---------|
| MAIN TO BLDG. | <u>3/4"</u> | <u>P</u> | <u>124'</u> | <u>1-14-99</u> | | |
| MAIN TO PROP LINE | <u>3/4"</u> | <u>P</u> | <u>34'</u> | | | |
| PROP. LINE TO BLDG. | <u>3/4"</u> | <u>P</u> | <u>90</u> | | | |

ENTERS. 1501 BRANCHED INTO:

TAP SIZE: 1/2 PRESSURE 60 PSI _____ INCHES W C LOCATION 251 S. of center of

Easy St


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS BY S. Hultslett

MAIN-SIZE 2" C I _____ BARE STEEL _____ COATED STEEL _____ PLASTIC X YEAR INSTALLED _____

DEPTH: 3 FT 0 IN LOCATION 13' E. of center of Blackwood St

"A" P/S READING _____ TOTAL ANODES 1# 0 17# 0 L.R. # 29860

REMARKS

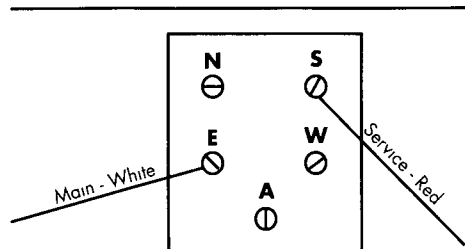

| Test Station | | |
|--|----------|-------|
| Reading & Location | Lead | Volts |
| P/S Pipeline Lead - Red New Service | S | |
| P/S Pipeline Lead - White Existing Main | E | |

ENG. DEPT. USE ONLY