

LOCATION 4005 Bolding St CITY Castroville
BETWEEN Burnside Dr STREET & STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	<u>5/8"</u>	<u>P</u>	<u>101'</u>	<u>6-27-02</u>		
MAIN TO PROP LINE	<u>5/8"</u>	<u>P</u>	<u>40'</u>			
PROP LINE TO BLDG	<u>5/8"</u>	<u>P</u>	<u>61'</u>			

ENTERS 400 BRANCHED INTO
TAP SIZE 3/4" PRESSURE 100 PSI INCHES W C LOCATION 251' N of center of Burnside Dr

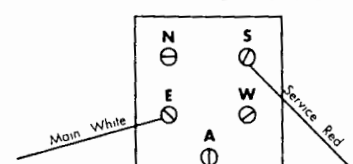
PRESSURE TEST @ 100 PSI FOR 10 min HRS BY S. Ziegler

MAIN-SIZE 2" C I BARE STEEL COATED STEEL PLASTIC YEAR INSTALLED

DEPTH 3 FT 0 IN LOCATION 11' W of center of S. Bolding St.

"A" P/S READING 0 TOTAL ANODES 1# 0 17# 0 LR # 153846

REMARKS

	Test Station		
	Reading & Location	Lead	Volts
	P/S Pipeline Lead - Red New Service	<u>S</u>	
	P/S Pipeline Lead - White Existing Main	<u>E</u>	