

LOCATION 1209 N. Boyce St. CITY Castroville

BETWEEN W. Lenox STREET & Sycamore St STREET.

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>5'</u>	<u>9-13-97</u>		
MAIN TO PROP. LINE						
PROP. LINE TO BLDG.						

ENTERS: 1209 BRANCHED INTO:

TAP SIZE: 3/4" PRESSURE 60 PSI INCHES W.C. LOCATION 125' S. of center of

Sycamore St


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS BY Schuffert

MAIN-SIZE 2' C.I. BARE STEEL COATED STEEL PLASTIC ✓ YEAR INSTALLED 1997

DEPTH: 5 FT. 0 IN. LOCATION 15' W. of center of N. Boyce St

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 L.R. #

REMARKS: Tied over 74' Existing 3/4" Plastic Service

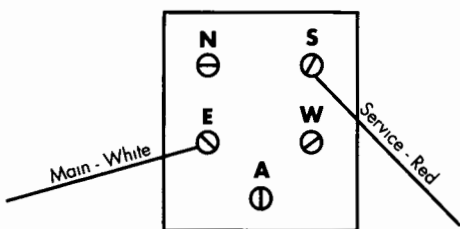

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	
P/S Pipeline Lead - White Existing Main	E	

ENG. DEPT. USE ONLY