

905 Brandon

CITY *Gastonia*

BETWEEN *Craver*

STREET & *McGuire*

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	$\frac{3}{4}$	<i>P</i>	<i>1' pipe to tie over C/O</i>	<i>12-11-91</i>		
MAIN TO PROP. LINE						
PROP. LINE TO BLDG.			<i>300'</i>			

ENTERS: ~~305~~ *905*

BRANCHED INTO:

TAP SIZE:  $\frac{3}{8}$  PRESSURE *60* P.S.I. INCHES W.C. LOCATION *108 South of center of Craven*


PRESSURE TEST: @ *100* psi For *1/4* Hrs. By *JP*

MAIN-SIZE *2"* C.I. — BARE STEEL — COATED STEEL — PLASTIC ☒ YEAR INSTALLED *1991*

DEPTH: *2* Ft. *6* In. LOCATION *17' E of Center of Brandon*

"A" P/S READING *.8* TOTAL ANODES 1\* *1* 17\* — L.R. # —

REMARKS: *tracer wire tied off at main*

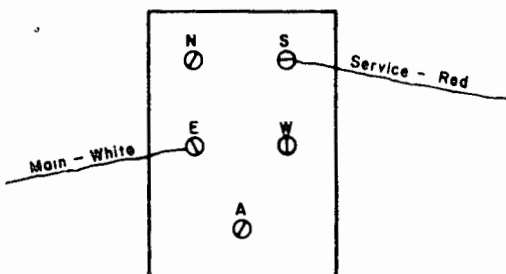

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<i>R</i>	<i>1.30</i>
P/S Pipeline Lead - White Existing Main	<i>E</i>	

ENG. DEPT. USE ONLY