

LOCATION 908 Broad st. CITY East.
BETWEEN Broad st. STREET & Linden Cir STREET

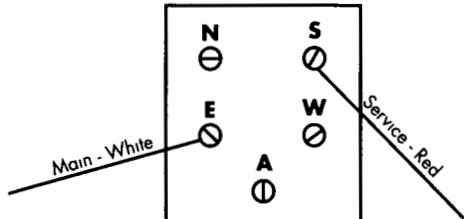
	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P.</u>	<u>22'</u>		<u>9-29-77</u>	
MAIN TO PROP. LINE	<u>"</u>	<u>"</u>	<u>2'</u>			
PROP. LINE TO BLDG.	<u>"</u>	<u>"</u>	<u>15'</u>			

ENTERS: SAME BRANCHED INTO:
TAP SIZE: 3/4" PRESSURE 60 PSI _____ INCHES W.C. LOCATION 135' from E of Broad st.

PRESSURE TEST: @ 100 PSI FOR 1/4 HRS BY D.F.
MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1977
DEPTH: 3 FT. 0 IN. LOCATION S. OF Linden Cir

"A" P/S READING P. TOTAL ANODES 1# - 17# - L.R. # -

REMARKS:

	Test Station			ENG. DEPT. USE ONLY
	Reading & Location	Lead	Volts	
	P/S Pipeline Lead - Red New Service	S		
	P/S Pipeline Lead - White Existing Main	E		