

LOCATION 416 S. BroadCITY GASTON, N.C.BETWEEN 3rdSTREET & 4th

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>4'</u>	<u>2-9-94</u>	<u>Tied over</u>	<u>110' of Ext</u>
MAIN TO PROP. LINE					<u>3/4 Plastic to Ext</u>	<u>2" Plastic</u>
PROP. LINE TO BLDG.					<u>main</u>	

ENTERS: 416BRANCHED INTO: 0

TAP SIZE: 1/2 PRESSURE 60 P.S.I. _____ INCHES W.C. LOCATION 27' E of Cot Broad
195' W of Cot A 4th or Union Rd.


PRESSURE TEST: @ 100 psi For 14 Hrs. By EP

MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1993

DEPTH: 3 Ft. 6 In. LOCATION _____

"A" P/S READING P TOTAL ANODES 1* 17* _____ L.R. # _____

REMARKS:

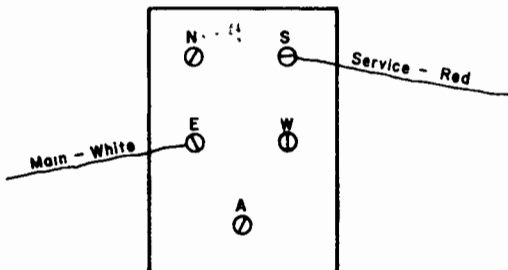

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>P</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY