

LOCATION 900 Cairnsmore Pl. CITY GASTON  
BETWEEN \_\_\_\_\_ STREET & \_\_\_\_\_ STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	<u>5/8"</u>	<u>P</u>	<u>86'</u>	<u>1-22-03</u>		
MAIN TO PROP LINE	<u>5/8"</u>	<u>P</u>	<u>0</u>			
PROP LINE TO BLDG	<u>5/8"</u>	<u>P</u>	<u>86'</u>			

ENTERS 900 BRANCHED INTO 906  
TAP SIZE 1/2 PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION 52' N. of south  
of Cairnsmore Pl.


PRESSURE TEST @ 100 PSI FOR 44 HRS BY S.H.

MAIN SIZE 3/4" C I \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL ☒ PLASTIC \_\_\_\_\_ YEAR INSTALLED \_\_\_\_\_

DEPTH 2 FT 0 IN LOCATION 31' W. of center of Cul-de-Sac

"A" P/S READING 1.0 TOTAL ANODES 1# 0 17# 0 LR # 4850

REMARKS \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

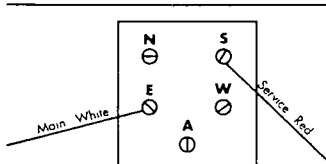

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	
P/S Pipeline Lead - White Existing Main	<u>E</u>	