

LOCATION 214 S. Church CITY Castroville
BETWEEN Franklin Blv. STREET & 2nd Ave STREET


	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>D</u>	<u>52'</u>		<u>52' of 3/4" BARE</u>	
MAIN TO PROP. LINE	<u>3/4</u>	<u>D</u>	<u>5'</u>		<u>12-10-94</u>	
PROP. LINE TO BLDG.	<u>3/4</u>	<u>D</u>	<u>47'</u>			

ENTERS: 214 BRANCHED INTO: 0
TAP SIZE: 3/8 PRESSURE 60 P.S.I. INCHES W.C. LOCATION

PRESSURE TEST: @ 100 psi For 1 1/4 Hrs. By EP
MAIN-SIZE 4" C.I. BARE STEEL COATED STEEL ✓ PLASTIC YEAR INSTALLED 1956
DEPTH: 3 Ft. 0 In. LOCATION

"A" P/S READING 110 TOTAL ANODES 1* 0 17* 0 L.R. #

REMARKS:

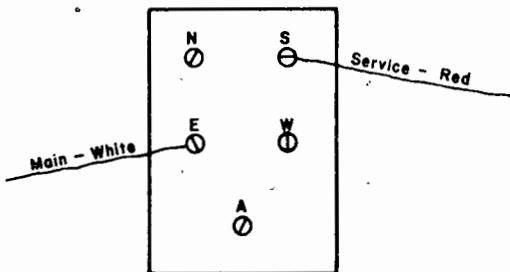

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>Plastic</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY