

LOCATION 303 S Church St CITY Los Angeles
BETWEEN E 2nd STREET & Echols STREET

| | SIZE | TYPE | S LENGTH ρ | | INSTALLED | RETIRED | RENEWED |
|---------------------|------------|------|-----------------|----------|----------------------------------|---------|---------|
| MAIN TO BLDG. | <u>3/4</u> | | <u>138</u> | <u>3</u> | <u>1' below</u> <u>4-9-94</u> | | |
| MAIN TO PROP. LINE | <u>3/4</u> | | <u>31</u> | <u>0</u> | | | |
| PROP. LINE TO BLDG. | <u>3/4</u> | | <u>107</u> | <u>3</u> | | | |

ENTERS: 303 BRANCHED INTO:
TAP SIZE: 1/2 PRESSURE _____ P.S.I. _____ INCHES W.C. LOCATION Waste House

PRESSURE TEST: @ 100 psi For 1/4 Hrs. By Bennett


MAIN-SIZE 2 C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1993

DEPTH: 2 Ft. 6 In. LOCATION 18' E of St

"A" P/S READING .60 TOTAL ANODES 1* 1 17* _____ L.R. # _____

REMARKS:

~~Bare~~ Main Replacement
Program

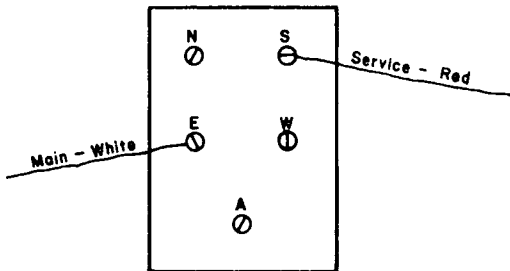

| Test Station | | |
|---|----------|------------|
| Reading & Location | Lead | Volts |
| P/S Pipeline Lead - Red New <u>Service</u> | <u>S</u> | <u>1.0</u> |
| P/S Pipeline Lead - White Existing Main | <u>E</u> | |

ENG. DEPT. USE ONLY