

LOCATION 409 S Church StCITY GastoniaBETWEEN 3rdSTREET & 2nd

STREET.

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>		<u>4-9-94 62'</u>		
MAIN TO PROP. LINE				<u>EX-3ft 3/4 P</u>		
PROP. LINE TO BLDG.				<u>TIED OVER</u>		

ENTERS: 409

BRANCHED INTO:

TAP SIZE: 1/2

PRESSURE

60

P.S.I.

INCHES W.C.

LOCATION

65' N OFEast 3rd.PRESSURE TEST: @ 100 psi For 1/4 Hrs. By M. ParkerMAIN-SIZE 2"

C.I.

BARE STEEL

COATED STEEL

PLASTIC KYEAR INSTALLED 94DEPTH: 3Ft. 0 In.LOCATION 14' E OF S Church

"A" P/S READING


P rised

TOTAL ANODES 1#

17#

L.R. #

REMARKS:

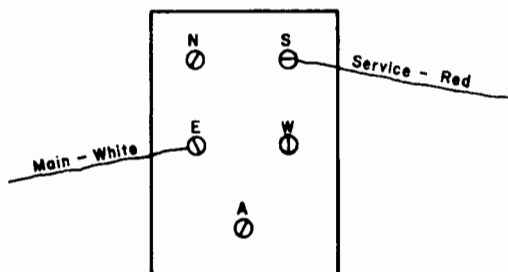

Test Station

ENG. DEPT. USE ONLY

Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	
P/S Pipeline Lead - White Existing Main	<u>E</u>	