

LOCATION 900 Cloister DR CITY Castroville

BETWEEN Augusta CT STREET & _____ STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	<u>5/8"</u>	<u>P</u>	<u>116'</u>	<u>12-6-02</u>		
MAIN TO PROP LINE	<u>5/8"</u>	<u>P</u>	<u>10'</u>			
PROP LINE TO BLDG	<u>5/8"</u>	<u>P</u>	<u>106'</u>			

ENTERS 900 BRANCHED INTO _____

TAP SIZE 3/4" PRESSURE 60 PSI _____ INCHES W C LOCATION 4' W. of center of Cloister Dr.


PRESSURE TEST @ 100 PSI FOR 4 HRS BY S.H.

MAIN-SIZE 2" C I _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1989

DEPTH 3 FT 0 IN LOCATION 51' E. of center of Cul-de-Sac

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 LR# 463835

REMARKS

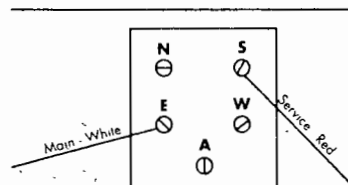

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	
P/S Pipeline Lead - White Existing Main	<u>E</u>	