

LOCATION 914 Crowder Woods Dr CITY Castroville

BETWEEN Hope Manor Ct. STREET & STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	5/8"	P	102'	1-29-03		
MAIN TO PROP LINE	5/8"	P	45'			
PROP LINE TO BLDG	5/8"	P	57'			

ENTERS 914 BRANCHED INTO

TAP SIZE 3/4" PRESSURE 100 PSI INCHES W C LOCATION 49' SE. of center of Hope Manor Ct.


PRESSURE TEST @ 100 PSI FOR 4 HRS BY S.H.

MAIN-SIZE 2" C I        BARE STEEL        COATED STEEL        PLASTIC ✓ YEAR INSTALLED 2002

DEPTH 3 FT 0 IN LOCATION 20' SW. of center of Crowder Woods Dr

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 LR # 32253

REMARKS

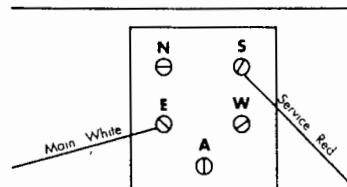

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	
P/S Pipeline Lead - White Existing Main	E	