

LOCATION 400 Drake Ave CITY Cottman
BETWEEN Ruby STREET & Crescent Ln STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>67'</u>			
MAIN TO PROP. LINE	<u>3/4</u>	<u>P</u>	<u>0'</u>			<u>9-26-96</u>
PROP. LINE TO BLDG.	<u>3/4</u>	<u>P</u>	<u>67'</u>			


ENTERS: 400 BRANCHED INTO: 0

TAP SIZE: 1" Ser. PRESSURE 20 P.S.I. INCHES W.C. LOCATION

PRESSURE TEST: @ 105 psi For 44 Hrs. By EP
MAIN-SIZE 1" C.I. BARE STEEL COATED STEEL PLASTIC YEAR INSTALLED
DEPTH: 1 Ft. 6 In. LOCATION

"A" P/S READING .5 TOTAL ANODES I# 07#0 L.R. #

REMARKS: NO Anode Installed, have pipe to be Retup & Renewed with new.

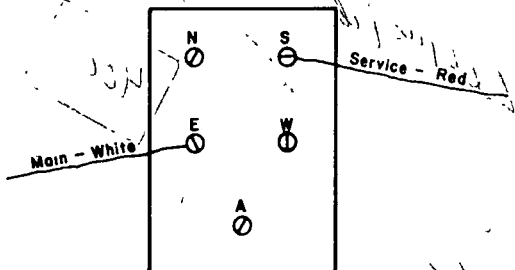

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>Plastic</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY