

LOCATION 130 + 156 Dixon Cir.

CITY Gastonia

BETWEEN S. Marietta St.

STREET &amp; Oak Valley Dr.

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.						
MAIN TO PROP. LINE						
PROP. LINE TO BLDG.						

ENTERS:

BRANCHED INTO:

TAP SIZE:

PRESSURE \_\_\_\_\_ PSI \_\_\_\_\_ INCHES W.C.

LOCATION


PRESSURE TEST: @ \_\_\_\_\_ PSI FOR \_\_\_\_\_ HRS. BY \_\_\_\_\_

 MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL ☒ PLASTIC \_\_\_\_\_ YEAR INSTALLED 1960
DEPTH: 3' FT. Ø IN. LOCATION Dixon Cir."A" P/S READING 990

TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS: 130 Dixon Cir. Bonded insulator on 3/4" C+W service line, which comes off of existing 3/4" C+W service at 156 Dixon Cir. C.P. #1845 / Readings: .565 before bond and .760 after bond was made.

156 Dixon Cir. Bonded 3/4" C+W service toe to 2" C+W gas main. Also cleared a water line "short" on the 3/4" C+W gas service. / Readings: .700 before bond and .950 after bond was made and "short" was cleared. C.P. #1845

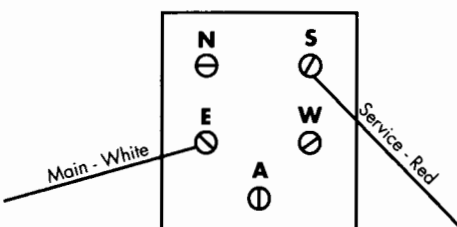

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<b>S</b>	
P/S Pipeline Lead - White Existing Main	<b>E</b>	

ENG. DEPT. USE ONLY