

LOCATION 115, 125, + 131 Dixon Cir.

CITY Gastonia

BETWEEN S. Marietta ST.

STREET &amp; Oak Valley Dr.

STREET

|                     | SIZE | TYPE | LENGTH | INSTALLED | RETIRED | RENEWED |
|---------------------|------|------|--------|-----------|---------|---------|
| MAIN TO BLDG.       |      |      |        |           |         |         |
| MAIN TO PROP. LINE  |      |      |        |           |         |         |
| PROP. LINE TO BLDG. |      |      |        |           |         |         |

ENTERS:

BRANCHED INTO:

TAP SIZE:

PRESSURE \_\_\_\_\_ PSI \_\_\_\_\_ INCHES W.C. LOCATION

PRESSURE TEST: @ \_\_\_\_\_ PSI FOR \_\_\_\_\_ HRS BY \_\_\_\_\_

MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL ☒ PLASTIC \_\_\_\_\_ YEAR INSTALLED 1960

DEPTH: 3' FT. 0 IN. LOCATION Dixon Cir.


"A" P/S READING .960 TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS: Bonded insulator on 3/4" C+U gas service. C.P. #1845.

Readings: 115 Dixon Cir. 1.000 before bond and 1.040 after bond was made.

125 Dixon Cir. 1.000 before bond and 1.078 after bond was made

131 Dixon Cir. 1.000 before bond and 1.040 after bond was made.

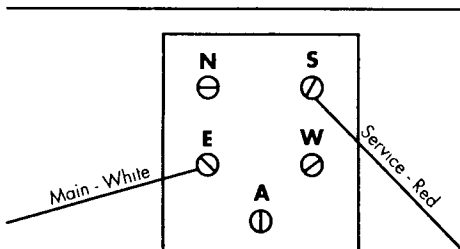

| Test Station                            |      |       |
|---|------|-------|
| Reading & Location                      | Lead | Volts |
| P/S Pipeline Lead - Red New Service     | S    |       |
| P/S Pipeline Lead - White Existing Main | E    |       |

ENG. DEPT. USE ONLY