

LOCATION 141, 147, + 153 Dixon Cir.

CITY Gastonia

BETWEEN Oak Valley Dr.

STREET &amp; S. Marriattice St.

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.						
MAIN TO PROP. LINE						
PROP. LINE TO BLDG.						

ENTERS:

BRANCHED INTO:

TAP SIZE: PRESSURE \_\_\_\_\_ PSI \_\_\_\_\_ INCHES W.C. LOCATION

PRESSURE TEST: @ \_\_\_\_\_ PSI FOR \_\_\_\_\_ HRS. BY \_\_\_\_\_

MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL ☒ PLASTIC \_\_\_\_\_ YEAR INSTALLED 1960


DEPTH: 3' FT. 0 IN. LOCATION Dixon Cir.

"A" P/S READING .960 TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS: Bonded insulated 3/4" service tee to existing 3/4" C&amp;W service line. C.P. #1845. Reading: .230 before bond + .985 after bond was made.

Bonded insulated 3/4" service tee to 2" C&amp;W Main C.P. 1845. Reading: .268 before bond + .965 after bond was made.

Isolated 3/4" C&amp;W service line. Reason: Insulator is under concrete. C.P. #1845. Reading: .960

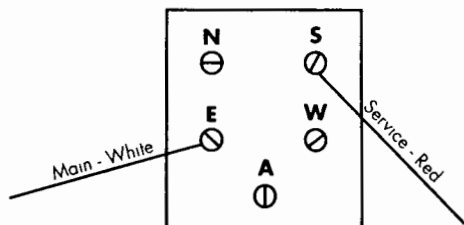

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	
P/S Pipeline Lead - White Existing Main	E	

ENG. DEPT. USE ONLY