

LOCATION 905 Edgewood C.RCITY BostonBETWEEN 8thSTREET & 9th

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>89'</u>	<u>10-8-93</u>		
MAIN TO PROP. LINE	<u>11</u>	<u>11</u>	<u>16'</u>			
PROP. LINE TO BLDG.	<u>11</u>	<u>11</u>	<u>73'</u>			

ENTERS: 905BRANCHED INTO: 0TAP SIZE: 1 1/2

PRESSURE

P.S.I.


INCHES W.C.

LOCATION 16' W. of C of EdgewoodPRESSURE TEST: @ 100 psiFor 1/4 Hrs.By JPMAIN-SIZE 2C.I. BARE STEEL ☒COATED STEEL PLASTIC YEAR INSTALLED 1954DEPTH: 2 Ft. 4 In.

LOCATION

"A" P/S READING 0.60TOTAL ANODES 1* 17* 1L.R. #

REMARKS:

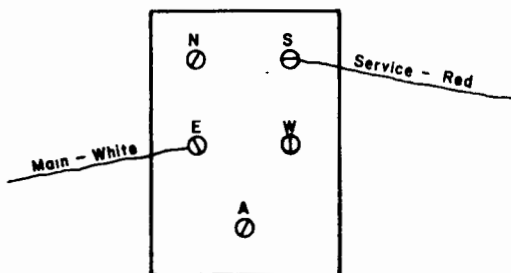

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>OR</u>	<u>P</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY