

LOCATION 1003 EDGEWOOD CIR. CITY EAST.

BETWEEN Ninth St. STREET & STREET

| | SIZE | TYPE | LENGTH | INSTALLED | RETIRED | RENEWED |
|---------------------|-------------|-----------|------------|-----------|---------|---------------|
| MAIN TO BLDG | <u>3/4"</u> | <u>P.</u> | <u>80'</u> | | | <u>4-3-97</u> |
| MAIN TO PROP. LINE | <u>"</u> | <u>"</u> | <u>8'</u> | | | |
| PROP. LINE TO BLDG. | <u>"</u> | <u>"</u> | <u>72'</u> | | | |

ENTERS. SAME BRANCHED INTO:

TAP SIZE: 3/4" PRESSURE 60 PSI _____ INCHES W.C. LOCATION 51' from @ of

Ninth St.


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS BY DNF

MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1997

DEPTH: 3 FT. 0 IN. LOCATION west side of edgewood cir

"A" P/S READING P. TOTAL ANODES 1# _____ 17# _____ L.R. # _____

REMARKS:

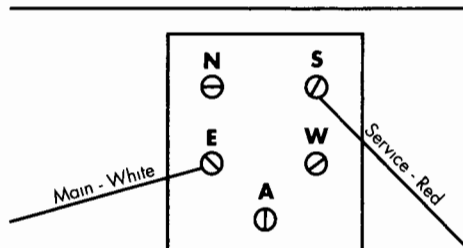

| Test Station | | |
|--|----------|-------|
| Reading & Location | Lead | Volts |
| P/S Pipeline Lead - Red New Service | S | |
| P/S Pipeline Lead - White Existing Main | E | |

ENG. DEPT. USE ONLY