

LOCATION 2637 Fairgreen DR CITY Castroville

BETWEEN Beatty Rd. STREET & STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>68'</u>	<u>8-14-96</u>		
MAIN TO PROP. LINE	<u>3/4"</u>	<u>P</u>	<u>5'</u>			
PROP. LINE TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>63'</u>			

ENTERS: 2637 BRANCHED INTO:

TAP SIZE: 1/2 PRESSURE 600 PSI          INCHES W.C. LOCATION 269' N. of center of


Beatty Rd.  
PRESSURE TEST: @ 100 PSI FOR 44 HRS. BY S. Huttstetter

MAIN-SIZE 2" C.I.          BARE STEEL          COATED STEEL          PLASTIC ✓ YEAR INSTALLED 1996

DEPTH: 3 FT. 0 IN. LOCATION 15' W. of center of Fairgreen DR

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 L.R. # 427686

REMARKS:

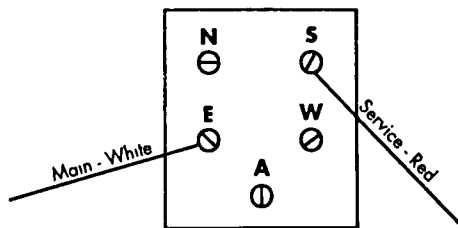

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY