

LOCATION 2003 Flint Ln. CITY CASL.
BETWEEN LANE st. STREET & BRYSON st. STREET

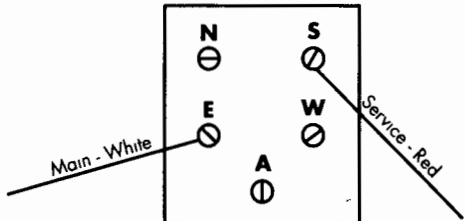
	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>1</u>	<u>32'</u>		<u>10-9-97</u>	
MAIN TO PROP. LINE	<u>"</u>	<u>"</u>	<u>4'</u>			
PROP LINE TO BLDG.	<u>"</u>	<u>"</u>	<u>28'</u>			

ENTERS: SAME BRANCHED INTO:
TAP SIZE: 3/4" PRESSURE 60 PSI INCHES W C LOCATION 20' From @ OF
LANE st.

PRESSURE TEST @ 100 PSI FOR 44 HRS BY D.F.
MAIN-SIZE 2" C.I. BARE STEEL COATED STEEL PLASTIC YEAR INSTALLED 1997
DEPTH: 3 FT. 0 IN LOCATION S. OF Flint Ln.

"A" P/S READING 1. TOTAL ANODES 1# 17# L.R. #

REMARKS:

	Test Station			ENG. DEPT. USE ONLY
	Reading & Location	Lead	Volts	
	P/S Pipeline Lead - Red New Service	S		
	P/S Pipeline Lead - White Existing Main	E		