

LOCATION 2105 FLINT LN CITY Cast.  
BETWEEN PAYSON ST. STREET & Dead end STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>46'</u>			<u>10-6-97</u>
MAIN TO PROP. LINE	<u>"</u>	<u>"</u>	<u>3'</u>			
PROP. LINE TO BLDG.	<u>"</u>	<u>"</u>	<u>43'</u>			

ENTERS: SAME

BRANCHED INTO

TAP SIZE. 3/4" PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION 176' from @ of PAYSON ST.


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS BY D.F.

MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ✓ YEAR INSTALLED 1997

DEPTH: 3 FT. 0 IN. LOCATION S. OF Flint LN

"A" P/S READING P. TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS:

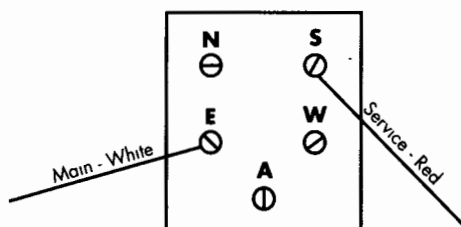

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<b>S</b>	
P/S Pipeline Lead - White Existing Main	<b>E</b>	

ENG. DEPT. USE ONLY