

LOCATION 217 Foster Dr. CITY Canton

BETWEEN Congress St STREET & STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>32'</u>	<u>10-8-96</u>		
MAIN TO PROP. LINE	<u>3/4"</u>	<u>P</u>	<u>18'</u>			
PROP. LINE TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>14'</u>			

ENTERS: 217 BRANCHED INTO:

TAP SIZE: 3/4" PRESSURE 60 P.S.I. INCHES W.C. LOCATION 589' W. of center of Congress St


PRESSURE TEST: @ 100 psi For 1/4 Hrs. By S. Huffstutz

~~MAIN~~ <sup>Service</sup> SIZE 3/4" C.I.      BARE STEEL      COATED STEEL      PLASTIC ☒ YEAR INSTALLED     

DEPTH: 1 Ft. 0 In. LOCATION 53' S. of center of Foster Dr.

"A" P/S READING P TOTAL ANODES 1\* 0 17\* 0 L.R. # 570450

REMARKS:

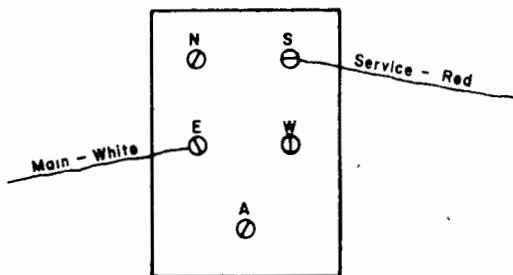

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	
P/S Pipeline Lead - White Existing Main	E	

ENG. DEPT. USE ONLY