

LOCATION 1900 Garland Ave CITY Houston

BETWEEN Sharon Lane STREET & _____ STREET

	SIZE	TYPE	P	LENGTH	S	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	3/4		3	20		<i>Replaced 8-13-94</i>		
MAIN TO PROP. LINE	3/4		3	4				
PROP. LINE TO BLDG.	3/4		6	16				

ENTERS: 1900 BRANCHED INTO:

TAP SIZE: 1/2 PRESSURE _____ P.S.I. _____ INCHES W.C. LOCATION Side phase

PRESSURE TEST: @ 100 psi For 114 Hrs. By Konek


MAIN-SIZE 2 C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC _____ YEAR INSTALLED 1993

DEPTH: 2 Ft. 6 In. LOCATION 14' W of Sharon Lane

"A" P/S READING .640 TOTAL ANODES 1* 1 17* _____ L.R. # _____

REMARKS:

~~Base~~ Main Replacement Program

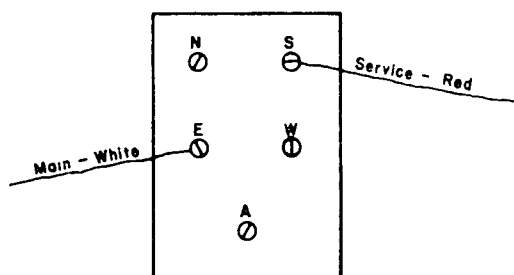

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline MAIN Lead - Red New Service	<i>Replaced</i> <u>S</u>	<u>1.20</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY