


LOCATION 1002 W. GarrisonCITY GastoniaBETWEEN ReidSTREET & Church

STREET

|                     | SIZE | TYPE | LENGTH | INSTALLED | RETIRED <input checked="" type="checkbox"/> | RENEWED |
|---------------------|------|------|--------|-----------|---|---------|
| MAIN TO BLDG.       | 3/4  | P    | 100'   |           |   | 8-2-97  |
| MAIN TO PROP. LINE  | 1'   | 1'   | 71'    |           |   |         |
| PROP. LINE TO BLDG. | 1'   | 1'   | 29'    |           |   |         |

ENTERS: 1002BRANCHED INTO: 742TAP SIZE: 1/2 PRESSURE \_\_\_\_\_ PSI \_\_\_\_\_ INCHES W.C. LOCATION 38' S. of C ofGarrisonPRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY EPMAIN-SIZE 10" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL ☒ PLASTIC \_\_\_\_\_ YEAR INSTALLED 1967DEPTH: 4 FT. 0 IN. LOCATION \_\_\_\_\_"A" P/S READING 1.20 TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS:

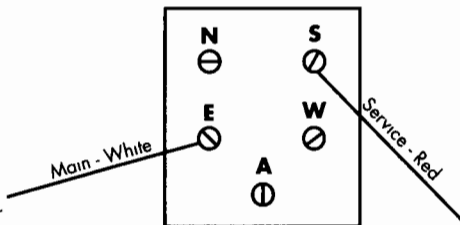

| Test Station                               |           |          |
|--|-----------|----------|
| Reading & Location                         | Lead      | Volts    |
| P/S Pipeline Lead - Red<br>New Service     | <u>ER</u> | <u>P</u> |
| P/S Pipeline Lead - White<br>Existing Main | <u>E</u>  |          |

ENG. DEPT. USE ONLY