

LOCATION 309 N. HIGHLAND St. CITY GAST.
BETWEEN RANKIN STREET & WALNUT STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>78</u>		<u>5.8</u>	<u>.96</u>
MAIN TO PROP. LINE	<u>"</u>	<u>"</u>	<u>8</u>			
PROP. LINE TO BLDG.	<u>"</u>	<u>"</u>	<u>70</u>			

ENTERS: 309 BRANCHED INTO:
TAP SIZE: 3/4" PRESSURE 60 PSI _____ INCHES W.C. LOCATION S. of 309


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY GL

MAIN-SIZE 2 C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC / YEAR INSTALLED 96

DEPTH: 3 FT. IN. LOCATION W. side of N. Highland

"A" P/S READING P TOTAL ANODES 1# _____ 17# _____ L.R. # _____

REMARKS:

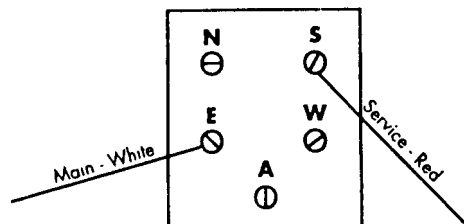

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>7</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY