

LOCATION 404 & 406 N. Highland St CITY East  
BETWEEN Murray STREET & Davidson STREET

	SIZE	TYPE	404 LENGTH	406	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	3/4"	P	67'	24		5.13	.96
MAIN TO PROP. LINE	"	"	37'	0			
PROP. LINE TO BLDG.	"	"	30'	24			

ENTERS: 404 BRANCHED INTO: 406

TAP SIZE: 3/4" PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION N. of 404  
S. of 406


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY GK

MAIN-SIZE 2 C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC / YEAR INSTALLED 96

DEPTH: 3 FT. IN. LOCATION W. Side of N. Highland

"A" P/S READING P TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS:

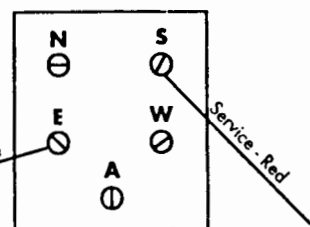

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	P
P/S Pipeline Lead - White Existing Main	E	

ENG. DEPT. USE ONLY