

LOCATION 406 Hill Crest CITY Coaston
BETWEEN 5 York STREET & McCarter STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>40'</u>			
MAIN TO PROP. LINE						
PROP. LINE TO BLDG.						

Tied over 93' 28" Ext 3/4 Plastic to Ext 2" Plastic when 2-21-98

ENTERS: 406 BRANCHED INTO: 0
TAP SIZE: 3/4 PRESSURE 60 PSI _____ INCHES W.C. LOCATION _____


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY EP

MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ✓ YEAR INSTALLED 1998

DEPTH: 3 FT. 6 IN. LOCATION _____

"A" P/S READING P TOTAL ANODES 1# 17# L.R. # _____

REMARKS: Tested Ext Service And 40' of New 3/4 Plastic 100psi 1/4 hr 2-21-98

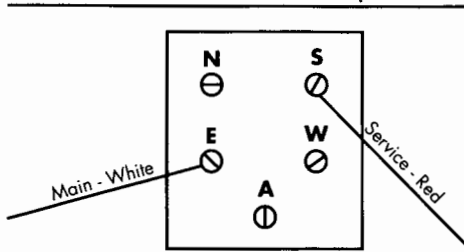

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>P/95hr</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY