

LOCATION 920 Holder Dr. CITY Castroville
BETWEEN Dead End. STREET & Stagecoach STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED <input checked="" type="checkbox"/>	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>D</u>	<u>145'</u>			
MAIN TO PROP. LINE	<u>3/4</u>	<u>D</u>	<u>30'</u>			<u>3-14-96</u>
PROP. LINE TO BLDG.	<u>3/4</u>	<u>D</u>	<u>115'</u>			

ENTERS: 920 BRANCHED INTO: 0

TAP SIZE: 3/8 PRESSURE 60 PSI _____ INCHES W.C. LOCATION


PRESSURE TEST: @ 100 PSI FOR 14 HRS. BY EP

MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED 1962

DEPTH: 2 FT. 6 IN. LOCATION

"A" P/S READING 1.3 TOTAL ANODES 1# 0 17# 0 L.R. # _____

REMARKS:

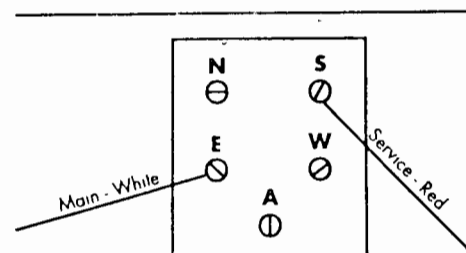

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>plastic</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY