

LOCATION 3775 Kennedy Rd. CITY Castroville  
BETWEEN Laver Ct STREET & Cul-de-Sac STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4'</u>	<u>P</u>	<u>106'</u>	<u>7-16-97</u>		
MAIN TO PROP. LINE	<u>3/4'</u>	<u>P</u>	<u>45'</u>			
PROP. LINE TO BLDG.	<u>3/4'</u>	<u>P</u>	<u>61'</u>			

ENTERS: 3775 BRANCHED INTO:  
TAP SIZE: 1/2 PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION 541' SE of center of


Laver Ct  
PRESSURE TEST: @ 100 PSI FOR 1 1/4 HRS. BY S. H. H. H. H.

MAIN-SIZE 2' C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ☒ YEAR INSTALLED \_\_\_\_\_

DEPTH: 3 FT. 0 IN. LOCATION 19' NW. of center of Kennedy Rd.

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 L.R. # 453690

REMARKS:

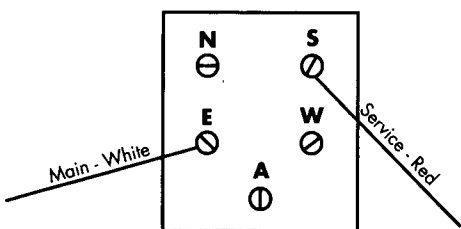

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<b>S</b>	
P/S Pipeline Lead - White Existing Main	<b>E</b>	

ENG. DEPT. USE ONLY