

LOCATION 1302 Laurel Woods DR. CITY GASTONIA

BETWEEN See Jany CD STREET & _____ STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	578'	P	121'	1-15-02		
MAIN TO PROP LINE	578'	P	45'			
PROP LINE TO BLDG	570'	P	76'			

ENTERS 1302 BRANCHED INTO _____

TAP SIZE 3/4" PRESSURE 60 PSI _____ INCHES W C LOCATION 667' E of center of See Jany CD


PRESSURE TEST @ 100 PSI FOR 14 HRS BY SK

MAIN-SIZE 2" C I _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 2001

DEPTH 3 FT 0 IN LOCATION 20' N. of center of Laurel Woods DR.

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 LR # A880361

REMARKS _____

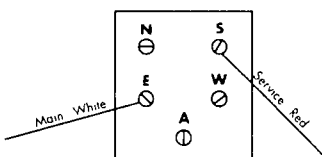

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	
P/S Pipeline Lead - White Existing Main	E	