

LOCATION 1 Learning PLACECITY GASTONIABETWEEN Sedgefield Dr. + End of RoadSTREET & End of Road (Parking Lot)

STREET

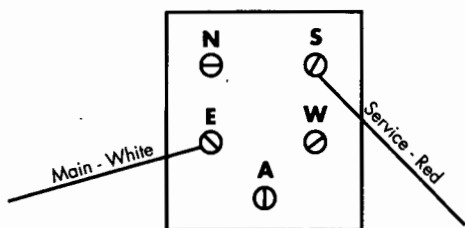
	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	2"	PL	51'	2-25-98		
MAIN TO PROP. LINE	2"	PL	16'	2-25-98		
PROP. LINE TO BLDG.	2"	PL	35'	2-25-98		

ENTERS:

BRANCHED INTO:

TAP SIZE: 2" PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION 602' W. of Center ofSedgefield Dr.PRESSURE TEST: @ 100 PSI FOR 17 HRS. BY TLMAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC X YEAR INSTALLED 2-25-98DEPTH: 3 FT. IN. LOCATION 602' West of Center of Sedgefield Dr.

"A" P/S READING \_\_\_\_\_ TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS: 2" PL SERVICE 51' From 2" Riser to Main. Main and SERVICE ARE The Same

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<b>S</b>	
P/S Pipeline Lead - White Existing Main	<b>E</b>	

ENG. DEPT. USE ONLY