

LOCATION 2059 LESLIE Dr. CITY Gasl.

BETWEEN Linda sl. STREET & Ashton Pl. STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P.</u>	<u>93'</u>		<u>7-10-97</u>	
MAIN TO PROP. LINE	<u>"</u>	<u>"</u>	<u>23'</u>			
PROP. LINE TO BLDG.	<u>"</u>	<u>"</u>	<u>70'</u>			

ENTERS: SAMC BRANCHED INTO: 2045 Leslie Dr.

TAP SIZE: 3/4" PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION 241' From @ of

Linda sl.


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY D.F.

MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ☒ YEAR INSTALLED 1992

DEPTH: 3 FT. 0 IN. LOCATION Southside of LESLIE Dr.

"A" P/S READING P TOTAL ANODES 1# — 17# — L.R. # —

REMARKS:

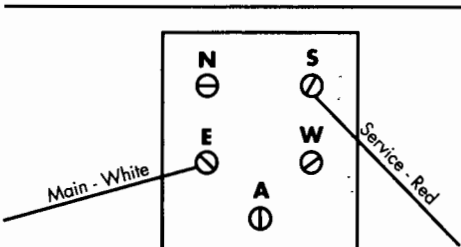

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<b>S</b>	
P/S Pipeline Lead - White Existing Main	<b>E</b>	

ENG. DEPT. USE ONLY